


PUMP TROUBLE ALARM FIELD INPUT DEFINITIONS

- PT 1
- PT 2
- PT 3
- PT 4
- PT 5
- PT 6
- PT 7
- PT 8

AUX ALARM CONTACTS
PROGRAM ALARM FUNCTION
VIA HMI TOUCH SCREEN ON DOOR

FIELD ALARM RELAY DEFINITIONS

- AUX 1
- AUX 2
- AUX 3
- AUX 4
- AUX 5
- AUX 6
- AUX 7
- AUX 8

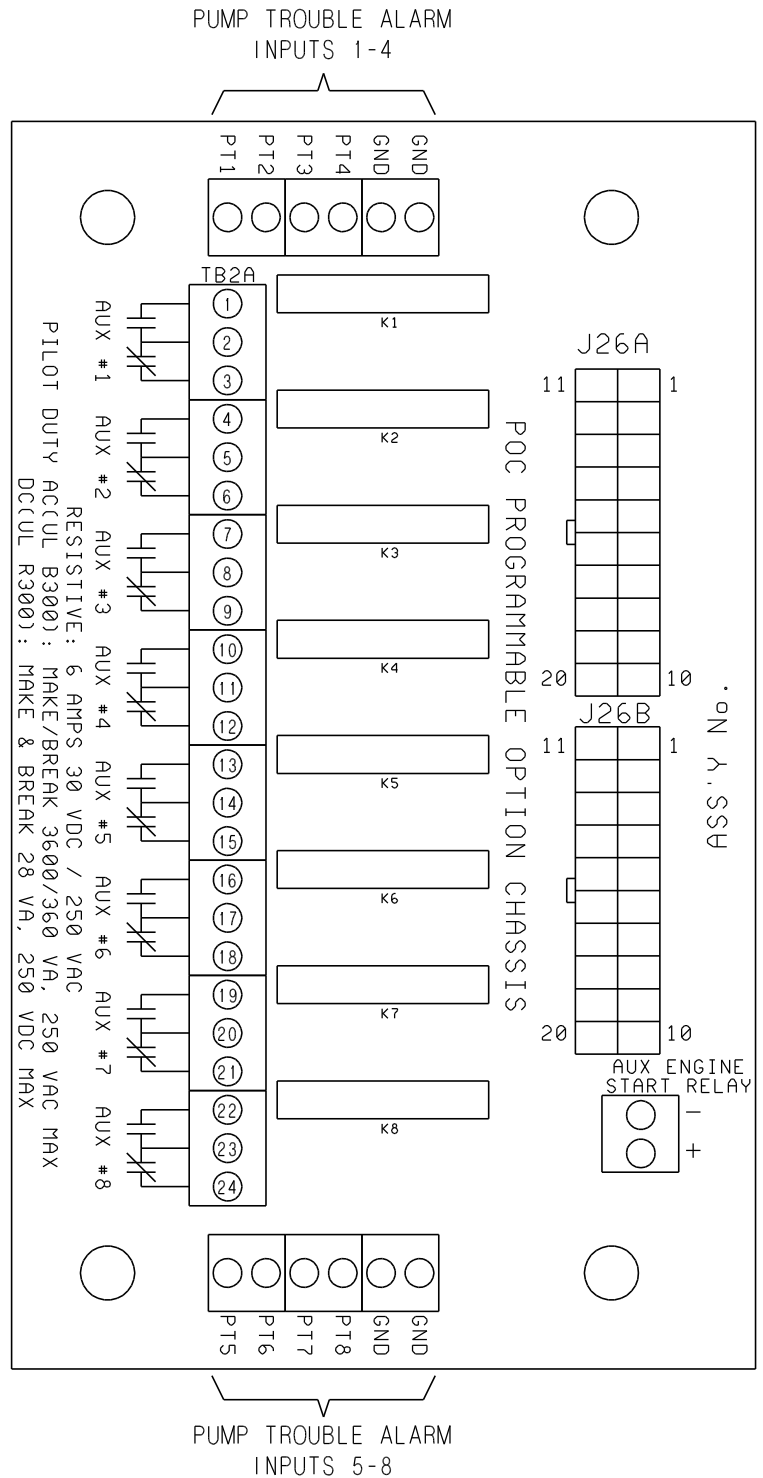

RESISTIVE: 6 AMPS 30 VDC / 250 VAC
 PILOT DUTY ACCUL B300: MAKE/BREAK 3600/360 VA, 250 VAC MAX
 DCCUL R300: MAKE & BREAK 28 VA, 250 VDC MAX