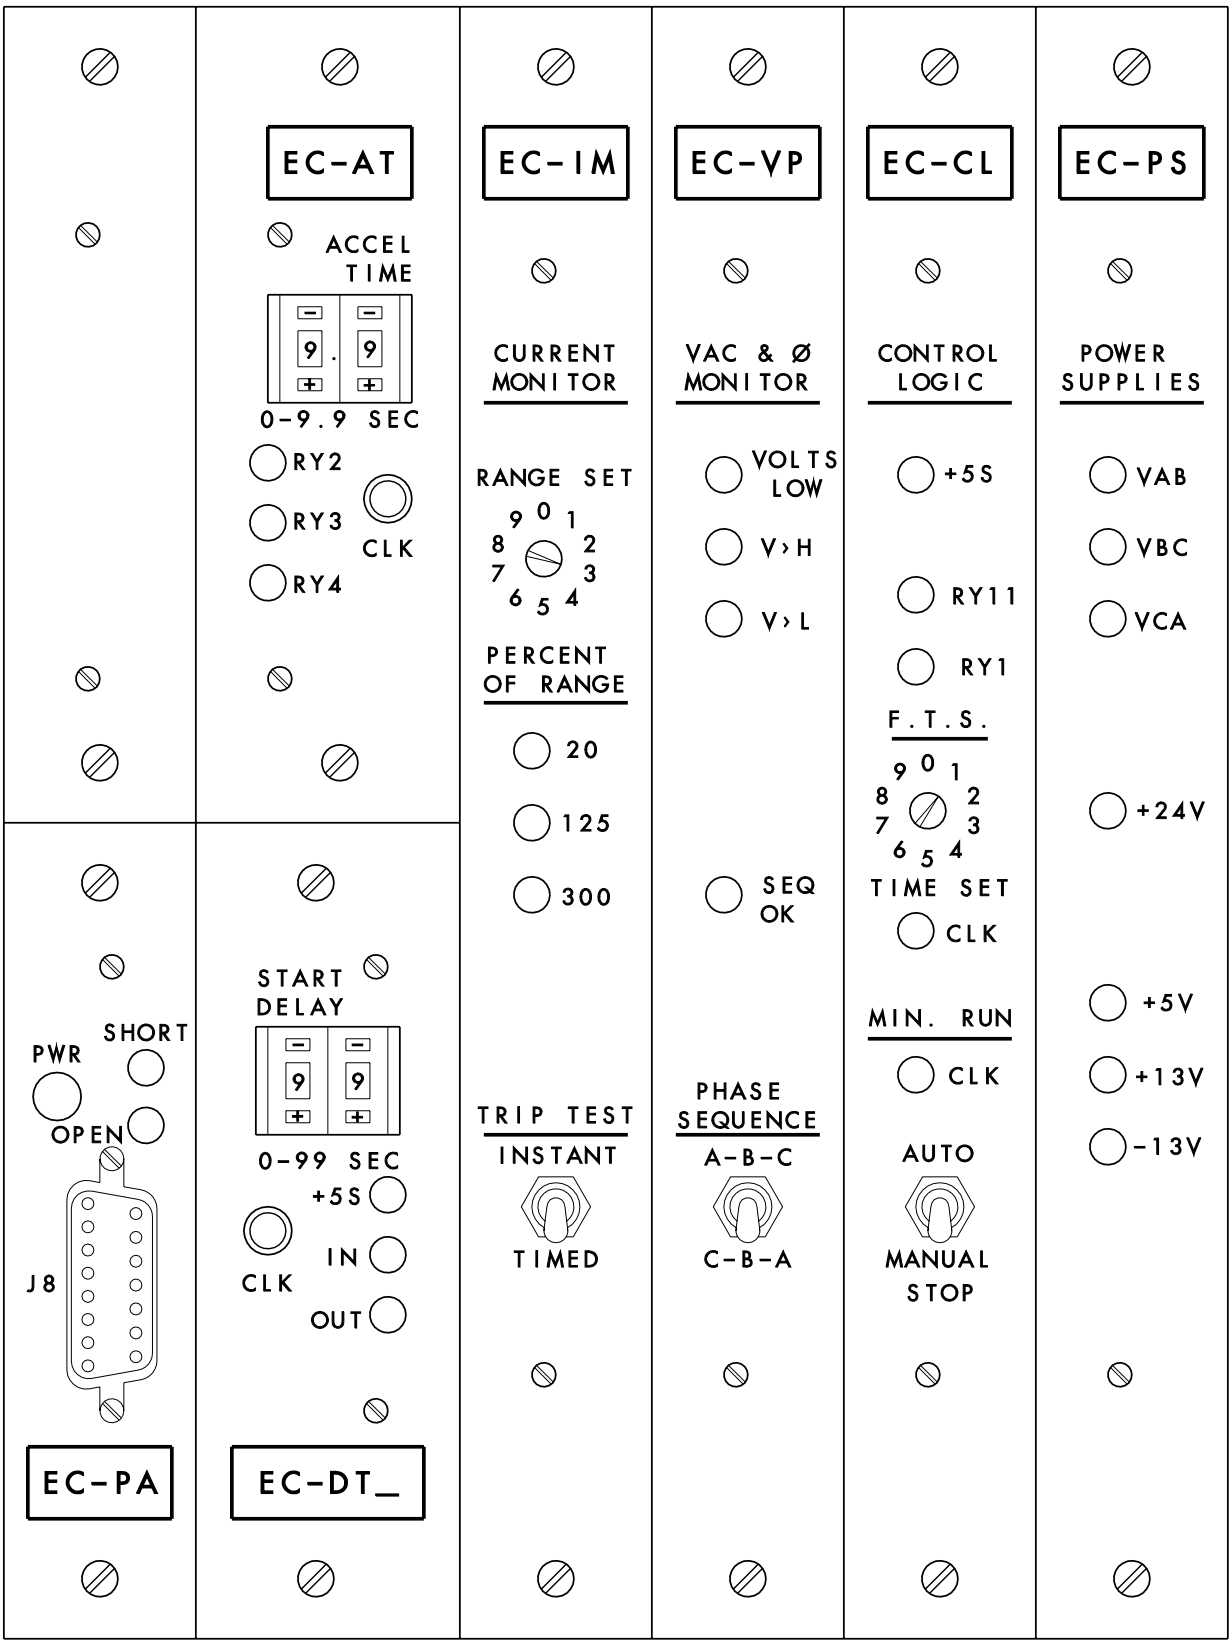
EC-AT
ACCEL TIME
9.9
0-9.9 SEC
RY2
RY3
RY4
CLK
EC-IM
CURRENT MONITOR
RANGE SET
0 1 2 3 4 5 6 7 8 9
PERCENT OF RANGE
20
125
300
TRIP TEST
INSTANT
TIMED
EC-VP
VAC & Ø MONITOR
VOLTS LOW
V>H
V>L
SEQ OK
PHASE SEQUENCE
A-B-C
C-B-A
EC-CL
CONTROL LOGIC
+5S
RY11
RY1
F.T.S.
TIME SET
CLK
MIN. RUN
CLK
AUTO
MANUAL STOP
EC-PS
POWER SUPPLIES
VAB
VBC
VCA
+24V
+5V
+13V
-13V
PWR
SHORT
OPEN
J8
EC-PA
START DELAY
9 9
0-99 SEC
+5S
IN
OUT
CLK
EC-DT_