


## CONTACTS ON TERMINALS

CLOSE to ALARM	OPEN to ALARM	DESIGNATION	RELAY	OPT./MOD
31-32	32-33	PUMP TROUBLE	RY22	"O"
34-35	35-36	PUMP RUN #2	RY24	17A
37-38	38-39	PUMP RUN #3	RY24	17B
40-41	41-42	PWR.FAIL #2	RY25	17C
43-44	44-45	PHASE SEQ.#2	RY26	17E
46-47	47-48	AC VOLTS LOW	RY23	"N"

This chassis is provided when one or more of the following is supplied:

OPT."O", MOD. 17A, 17B, 17C, 17E, OPT."N" -or- OPT."G"; SUPERVISORY POWER LOSS START (RELAY 21)

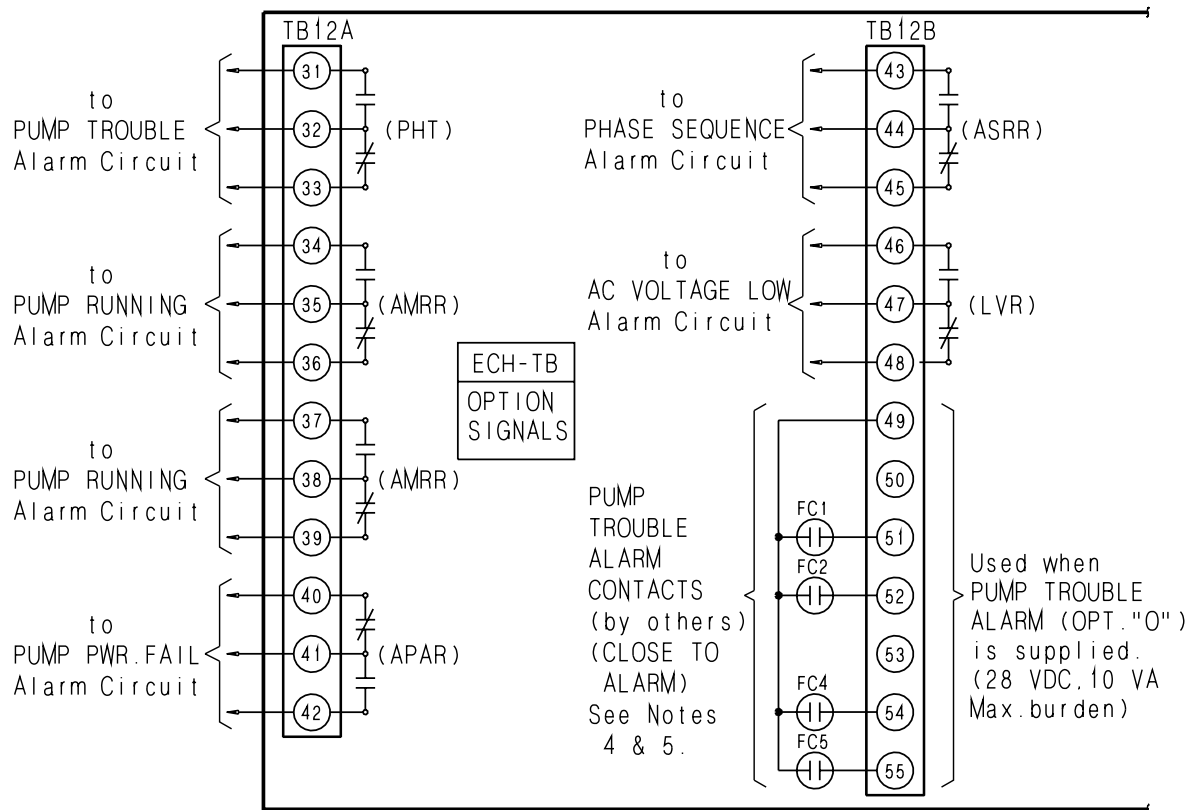

### NOTES:

- 1) All relay contacts shown DE-ENERGIZED.
- 2) All contacts shown in NORMAL STATE except RY25C & D (Term.40-42) which is shown in ALARM state.
- 3) Alarm (S.P.D.T.) contact rating:  
5.0 Amps at 115 Vac OR 28 Vdc.
- 4) FC1 Not Used when Option "N" is supplied  
FC4 Not Used when Mod 75 is supplied.
- 5) FC3 (Terminal 53) not available  
(Factory Connection)