


ISSUE	SUMMARY	
1	INITIAL ISSUE	11 DEC. 08
2	FUEL SPILL ALM	22 JUN. 09
3	ADDED RATINGS	27 JAN 11

ENGINE FAILURE ALARM

PUMPHOUSE TROUBLE ALARM (OPTIONAL)

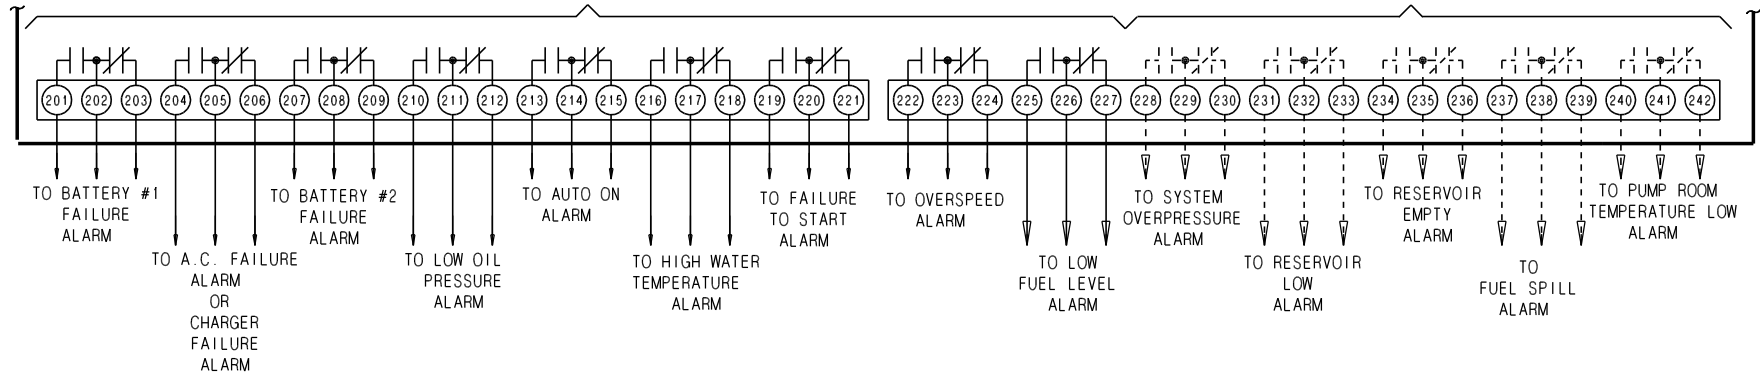

GOLD FLASH
 ALARM CONTACTS RATED:
 10A @ 28VDC
 10A @ 120VAC
 3A @ 120VDC

EXTERNAL DIAGRAM FOR OPT. 7 INDIVIDUAL ALARM CONTACTS IN SERIES DEC CONTROLLERS	
MASTER CONTROL SYSTEMS INC. LAKE BLUFF, ILLINOIS U.S.A.	
USED ON	REPLOT 27 JAN 11
DRN. <i>P</i>	DES.
APP.	DATE 11 DEC. 08
DWG. 17730	ISS. 3 SHEET 1 OF 1